


ECLIPSE #2 POST HYDRANT

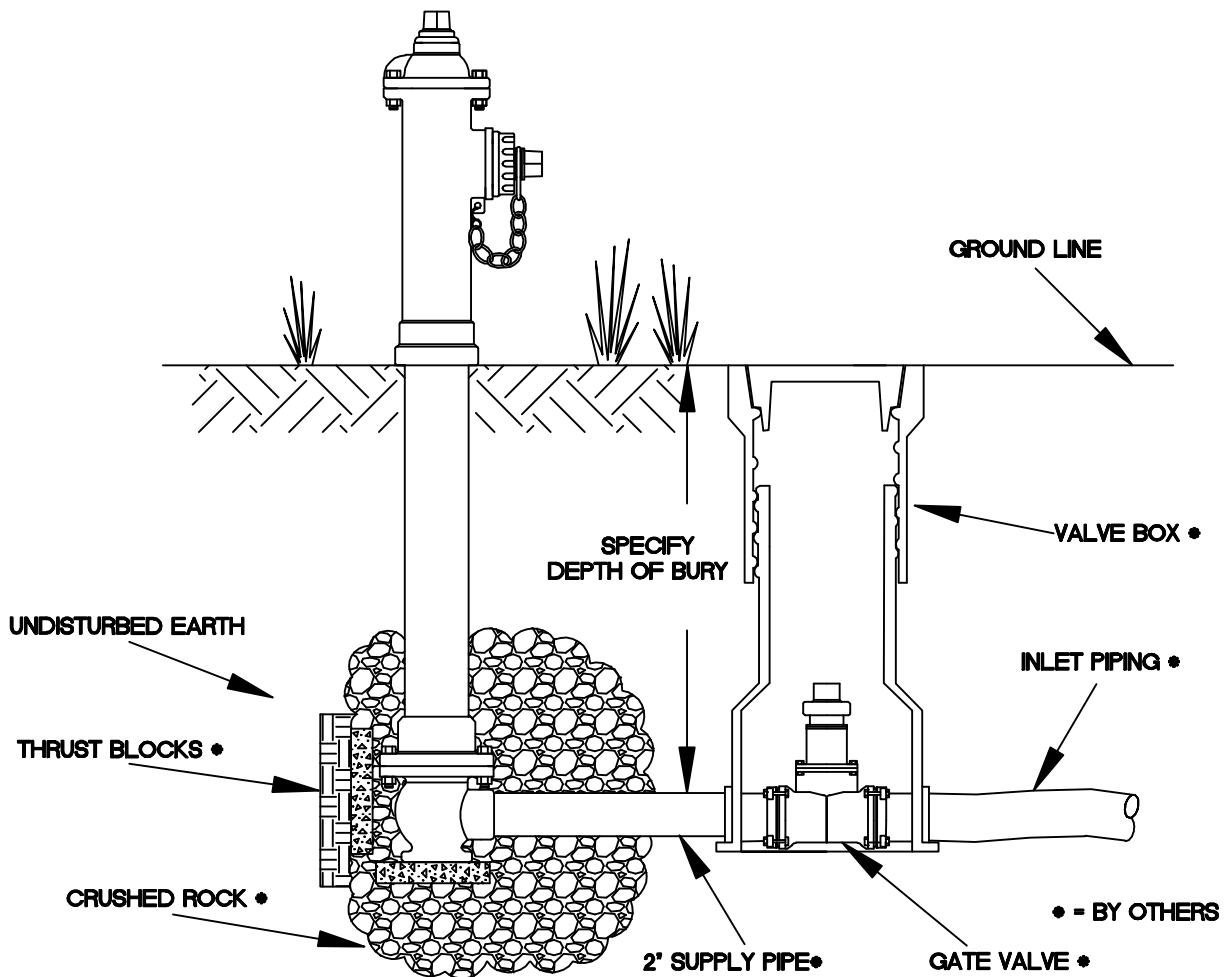


Hydrants shall be self-draining, non-freezing, compression type with 2-1/8" main opening. Inlet shall be (2", 2-1/2" + 3' FNPT, or 2", 3" or 4" MJ). Outlet shall be (3/4" GHT or 1", 1-1/4", 1-1/2", 2" or 2-1/2" MNPT or 1-1/2", 2" or 2-1/2" NST).

Hydrants shall have a (ductile iron (STD), galvanized steel, stainless steel, or brass) exterior casing pipe, a (galvanized (STD), stainless steel or brass) interior non-turning operating rod with a heavy wall (cast iron (STD), or aluminum) top stock.

Principal interior operating parts shall be brass, bronze and aluminum and be removable for servicing without excavating the hydrant.

Hydrants shall be set in 4 cubic feet of crushed stone to allow for proper drainage of the hydrant. Recommendations of the AWWA should be followed when installing the hydrant.

Hydrants shall be #2 Eclipse Post Hydrant as manufactured by John C. Kupferle Company, St. Louis, MO or approved equal.

		DRAWN F.M.		 KUPFERLE FOUNDRY COMPANY 2511 NORTH 9TH STREET, ST. LOUIS, MO 63102 314-231-8738 800-231-3000 FAX 314-231-2820 http://www.hydrants.com
		APPROVED		
		DATE 11-16-12		
		MAT'L		
THIS DRAWING IS THE PROPERTY OF THE KUPFERLE FOUNDRY COMPANY. IT IS NOT TO BE USED OR DUPLICATED WITHOUT PERMISSION OF THE OWNER.				
DATE	REVISION	PART NO. #2 ECLIPSE POST HYDRANT	SHEET	OF

