



# SUBMITTAL INFORMATION

## Pack Joint Coupling - (C77-xx-NL style)



**PACK JOINT FOR SCHEDULE 40 AND SCHEDULE 80 PVC OR DR-11 HDPE PIPE BOTH ENDS**

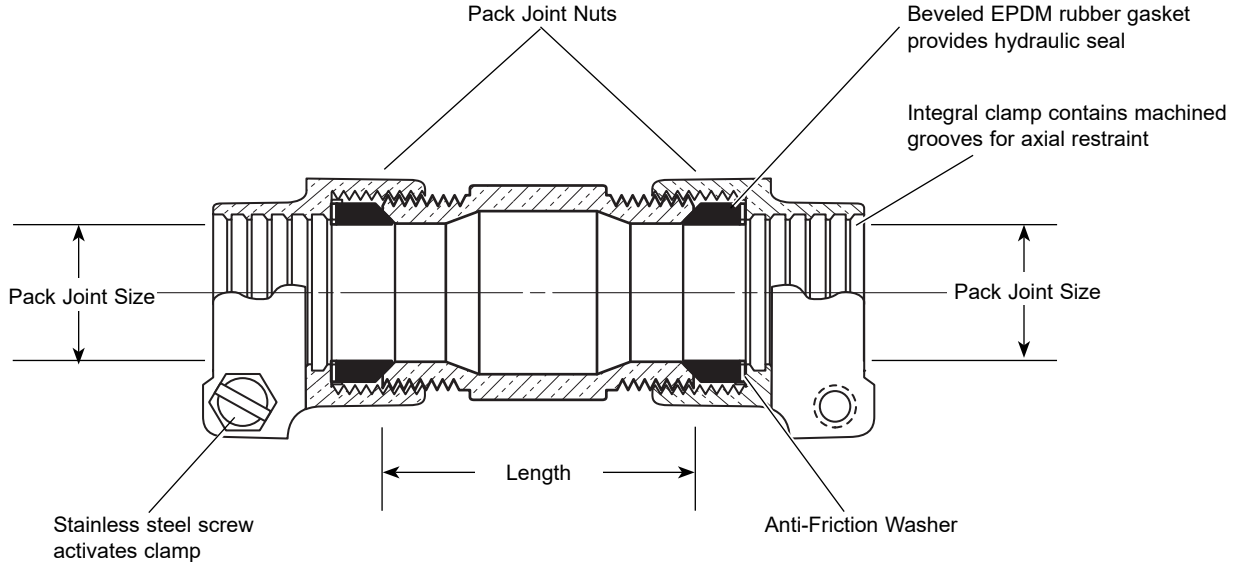

Due to design variations related to sizing, items may differ from images above.

DESCRIPTION		LENGTH	APPROX. WT. LBS	PART NUMBER	✓ SUBMITTED ITEM(S)
PACK JOINT	PACK JOINT				
1/2"	1/2"	2-1/16"	0.9	C77-11-NL	
3/4"	3/4"	2-1/8"	1.2	C77-33-NL	
3/4"	1"	1-5/16"	1.7	C77-34-NL	
1"	1"	2-1/2"	2.2	C77-44-NL	
1-1/4"	1-1/4"	3-5/8"	2.7	C77-55-NL	
1-1/2"	1-1/2"	3-5/8"	3.7	C77-66-NL	
2"	2"	4"	6.0	C77-77-NL	

**Note:** Ford® Pack Joints for PVC are only recommended for Schedule 40 and Schedule 80 PVC pipe, or DR-11 HDPE pipe with appropriate insert stiffener.

### FEATURES

- All brass that comes in contact with potable water conforms to AWWA Standard C800 (ASTM B584, UNS C89833)
- The product has the letters "NL" cast into the main body for lead-free identification
- Certified to NSF/ANSI Standard 61 and NSF/ANSI Standard 372 where applicable
- Brass components that do not come in contact with potable water conform to AWWA Standard C800 (ASTM B62 and ASTM B584, UNS C83600, 85-5-5-5)

The Ford Meter Box Company considers the information in this submittal form to be correct at the time of publication. Item and option availability, including specifications, are subject to change without notice. Please verify that your product information is current. Our standard warranty applies.



**The Ford Meter Box Company, Inc.**

P.O. Box 443, Wabash, Indiana U.S.A. 46992-0443

Phone: 260-563-3171 / Fax: 800-826-3487

Overseas Fax: 260-563-0167

www.fordmeterbox.com

03/18/21

Submitted By:



36 Hudson Rd  
Sudbury MA 01776



800-225-4616  
www.tisales.com